

Kidde Engineered Fire Suppression System


Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid



Effective: June 2015
K-45-9041

3-inch Swing Check Valve Installation

P/N: 06-118058-001

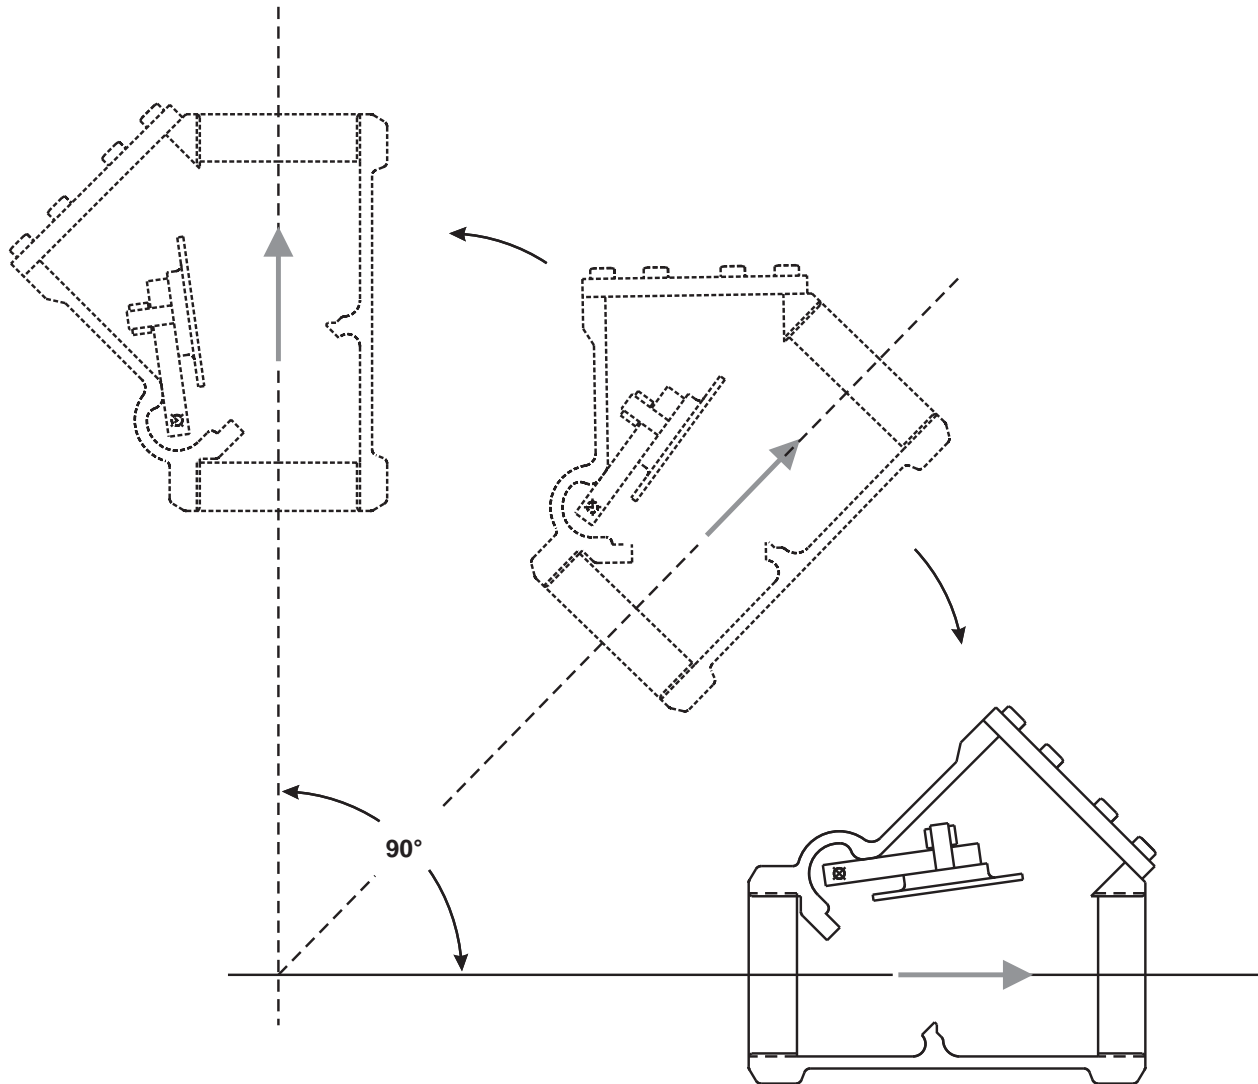

- UL Listed, ULC Listed, FM Approved for use with Novec 1230 Systems

Note:

1. Install the Check Valve so that the arrow is pointing in the direction of flow.
2. Install between 0 degrees and 90 degrees from the horizontal.

Kidde is a registered trademark of Kidde-Fenwal, Inc.

3M and Novec are trademarks of 3M.

All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems

400 Main Street

Ashland, MA 01721

Ph: 508.881.2000

Fax: 508.881.8920

www.kiddefiresystems.com