

# FM-200 COMPONENT DESCRIPTION


## Flexible Discharge Hoses

# FENWAL®

F-93-2120

### FEATURES

- FOR USE WITH UL LISTED, ULC LISTED & FMRC APPROVED SYSTEMS

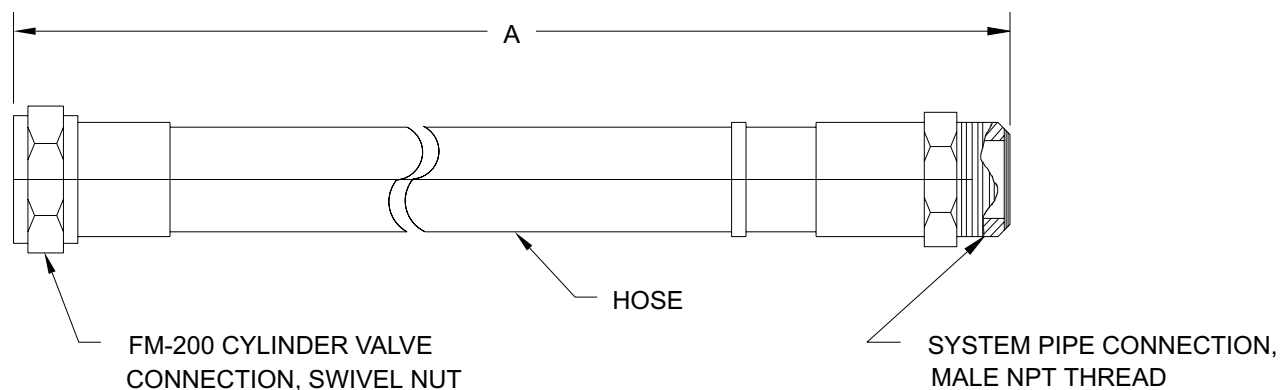

### ORDERING INFORMATION

| PART NO. | MALE NPT | A  | MIN. BED RADIUS |
|----------|----------|----|-----------------|
| 283898   | 1-1/2    | 24 | 10.5            |
| 283899   | 2        | 31 | 13.5            |
| 283900   | 2-1/2    | 48 | 22.5            |

### MATERIALS

HOSE: REINFORCED RUBBER HOSE

FITTING: BRASS

MINIMUM BURSTING PRESSURE: 2000 PSI

WORKING PRESSURE: 500 PSI

PROOF PRESSURE: 1000 PSI

# FENWAL®

KIDDE-FENWAL, INC.  
400 MAIN STREET, ASHLAND, MA 01721  
TEL: (508) 881-2000 FAX: (508) 881-8920  
www.fenwalfire.com



This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as described herein. If you need more information on this product, or if you have a question, contact KIDDE-FENWAL, INC., Ashland, MA 01721; Telephone (508) 881-2000