Kidde Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid

Effective: June 2015

Pressure Operated Switch Data Sheet

K-45-5180 Rev AD

FEATURES

- ***UL Listed, ULC Listed, and FM Approved for use with Novec 1230 Systems***

P/N: 81-486536-000

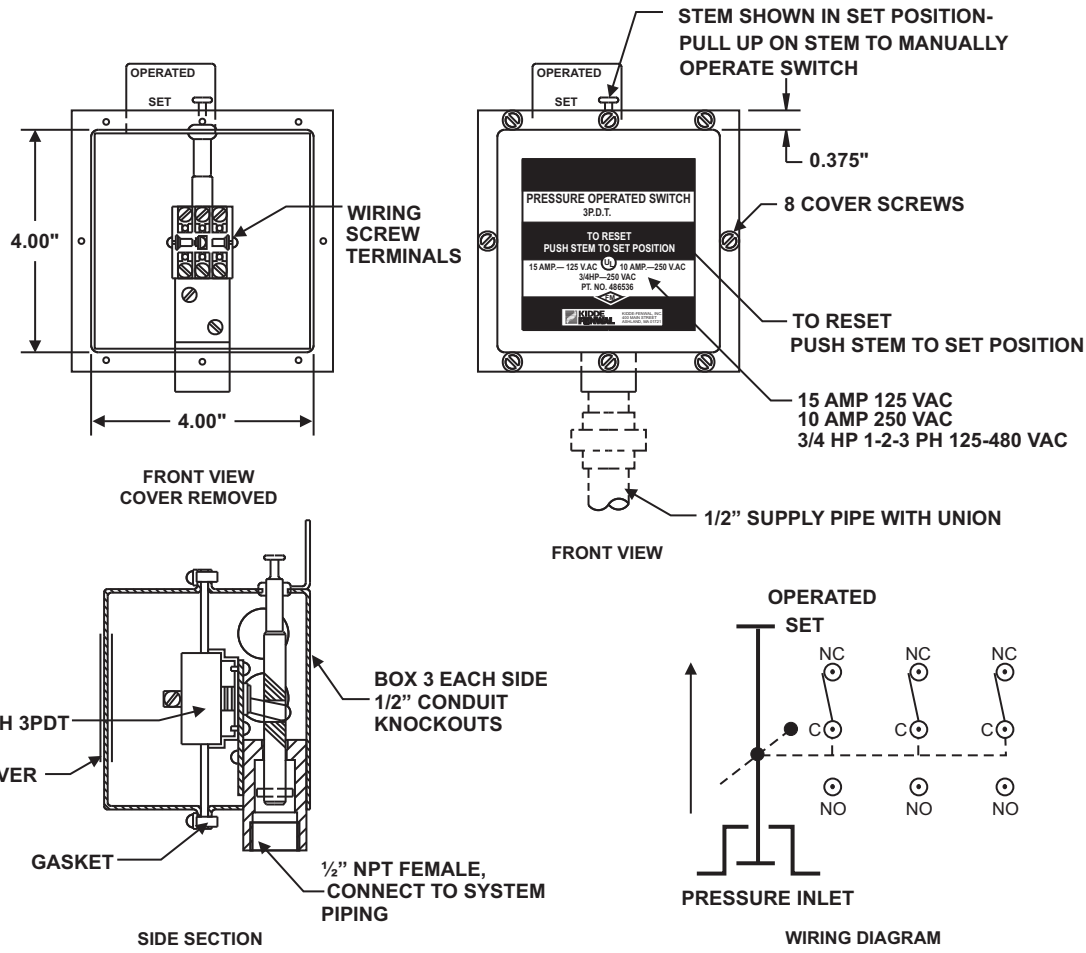

Notes:

- The switch may be mounted in any position, however, the preferred installation is upright, as shown.
- Any load connection to the switch must not exceed the switch rating, and shall utilize a suitable protection device (i.e., circuit breaker, fuse)

- Contact Ratings (3 PDT)
  - 15 Amp @ 125 Vac
  - 10 Amp @ 250 Vac
  - 3/4 HP @ 250 Vac
  - 1, 2, or 3 Phase

Kidde is a registered trademark of Kidde-Fenwal, Inc.
3M and Novec are trademarks of 3M.
All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, Inc.

©2015 Kidde-Fenwal, Inc.

Kidde Fire Systems
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com