Kidde Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid

Kidde Fire Systems
A UTC Fire & Security Company

Effective: March 2007
K-45-6060

Watertight Pull Box Installation Data Sheet

FEATURES

- ***For Use with UL Listed and FM Approved Systems***

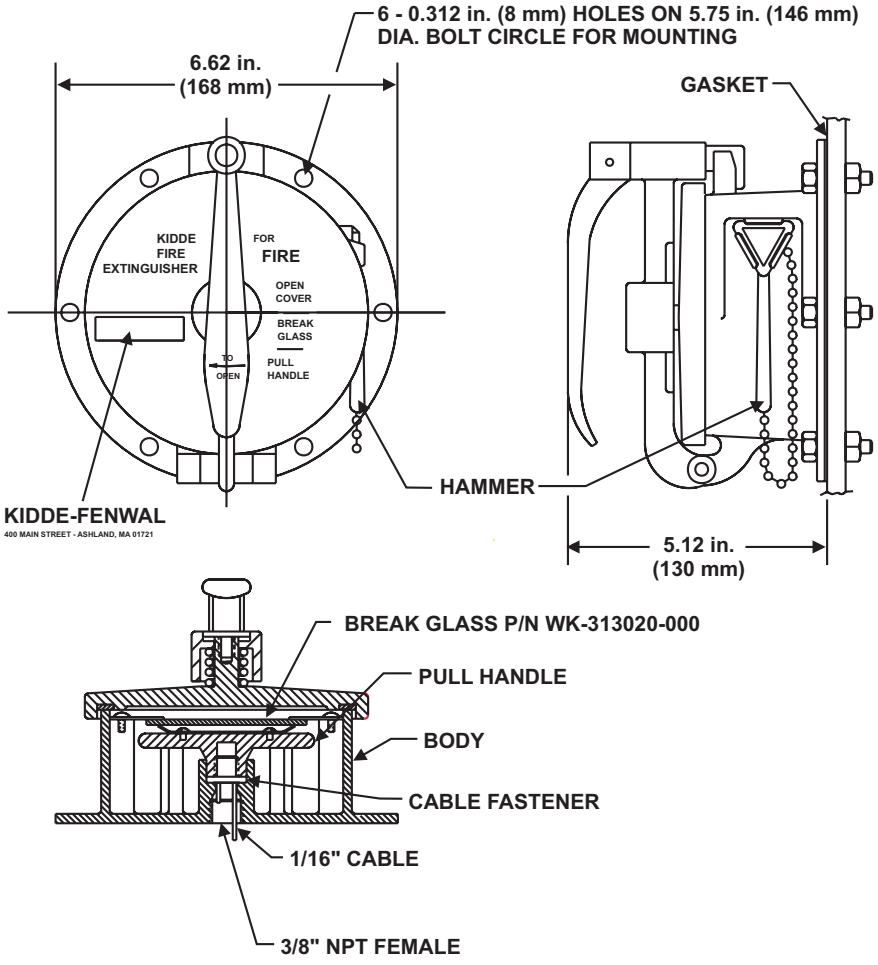

NOTE:

- Approved by Navy Dept. as per BU. Ships Letter DD 692/593/CV 9/593 (648) of 4-13-44 BU. Ships Dwg. 59300-551627

MATERIAL

- Finish: Red paint with black raised letters

Kidde is a registered trademark of Kidde-Fenwal, Inc.
3M and Novec are trademarks of 3M.
All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

© 2007 Kidde-Fenwal Inc.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com