FM-200® Component Description

Flexible Discharge Hoses

Kidde Fire Systems
A UTC Fire & Security Company

Effective: April 2007
K-90-2120

FEATURES

- ***For Use with UL Listed, ULC Listed and FM Approved Systems***
- ***See Kidde® Manual 90-FM200M-021 for USCG Approval***

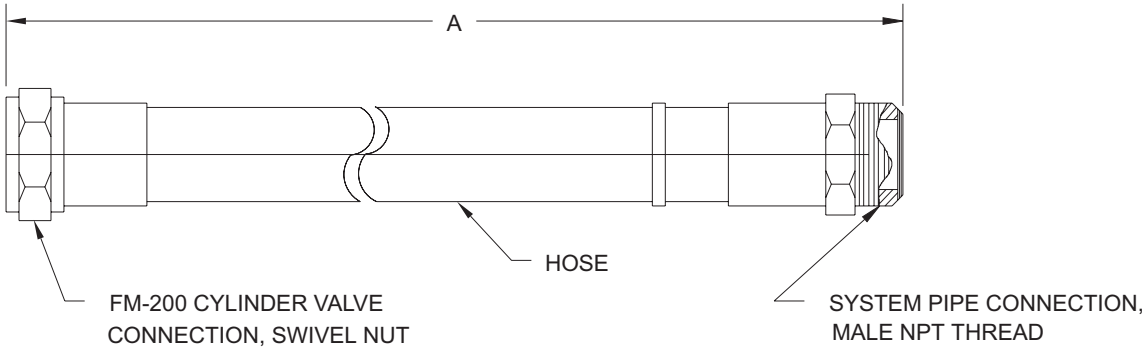

TECHNICAL DATA

- Minimum Bursting Pressure: 2000 PSI
- Working Pressure: 500 PSI
- Proof Pressure: 1000 PSI

MATERIALS

- Hose: Reinforced Rubber Hose
- Fitting: Brass

ORDERING INFORMATION

Part Number	Male NPT	A	Min. Bend Radius
283898	1½	24	10.5
283899	2	31	13.5
283900	2½	48	22.5
Note: Dimensions are in inches.			

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

K-90-2120 Rev AB
© 2007 Kidde-Fenwal Inc.
Printed in USA

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com

Kidde ECS Fire Suppression System Component Description

Effective: June 2014

Flexible Discharge Hoses

K-90-2120 Rev BA

FEATURES

- ***For Use with UL Listed, ULC Listed and FM Approved Systems***
- ***See Kidde® Manual 06-236225-001 for USCG Approval***
- ***RoHS Compliant***

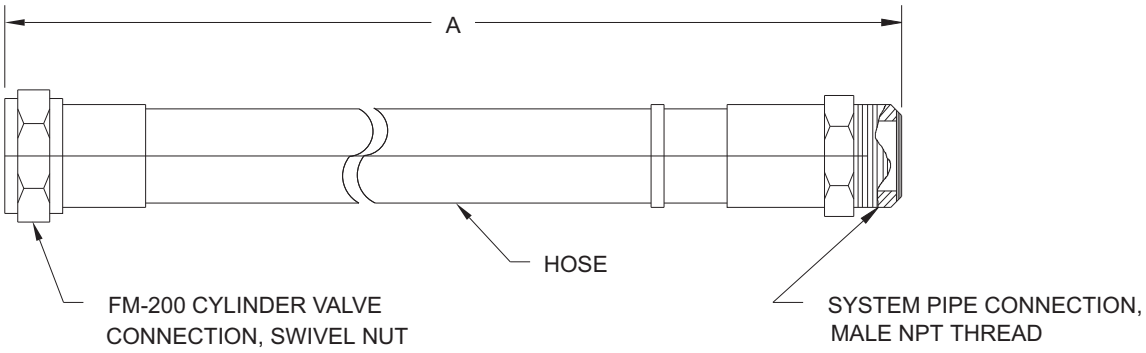

TECHNICAL DATA

- **Minimum Bursting Pressure:** 2000 PSI
- **Working Pressure:** 500 PSI
- **Proof Pressure:** 1000 PSI

MATERIALS

- **Hose:** Reinforced Rubber Hose
- **Fitting:** Cadmium-plated Steel

Part Number	Male NPT	A	Min. Bend Radius
WK-283898-000	1 1/2	24	10.5
WK-283899-000	2	31	13.5
WK-283900-000	2 1/2	48	22.5
06-118225-001	3	54	24

Dimensions are in inches.

COMPATIBILITY

Series	For Use With
Kidde ECS HFC-227ea	X
Kidde ECS Advanced Delivery FM-200®	X

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, Inc.

FM-200 is a registered trademark of E.I. du Pont de Nemours and Company. Kidde is a registered trademark of Kidde-Fenwal Inc. All other trademarks are the property of their respective owners.

©2014 Kidde-Fenwal, Inc.

Kidde Fire Systems
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com