FM-200® Component Description

Cylinder Mounting Straps

Kidde Fire Systems
A UTC Fire & Security Company

Effective: April 2007
K-90-8130

FEATURES

- ***For Use with UL Listed, ULC Listed and FM Approved Systems***

INDOREED
THE LEADING OF FIRE COMPANY PROVIDERS

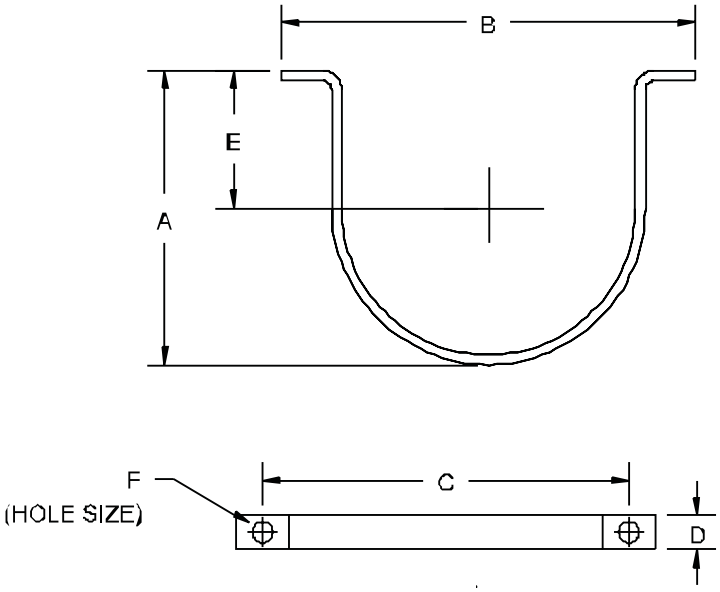

PART NO.	CYL. SIZE	CYL. O.D.		A		B		C		D		E		F	
		in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
283945	10, 20	7.07	1.80	6.48	165	9.62	244	8.62	219	1.00	25	2.78	71	.437	11.1
283934	40, 70	9.00	229	8.16	207	11.69	297	10.69	272	1.00	25	3.50	89	.437	11.1
292971	200 pre-3/98	13.60	345	13.09	332	17.06	433	15.44	392	1.75	44	6.06	154	.625	15.9
235317	125, 200	12.75	324	12.93	329	16.18	411	14.56	370	1.75	44	5.59	142	.625	15.9
281866	350	16.00	406	15.5	394	19.5	495	17.88	454	1.75	44	6.06	154	.625	15.9
294651	600	22.00	559	21.56	548	25.75	654	24.12	613	1.75	44	10.25	260	.625	15.9
236125	900	24.00	610	23.75	603	27.75	705	26.00	660	1.75	44	12.13	308	.625	15.9

MATERIALS

- Steel, Painted Black SAE 1020

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

© 2007 Kidde-Fenwal Inc.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com